




# Siren Wiring

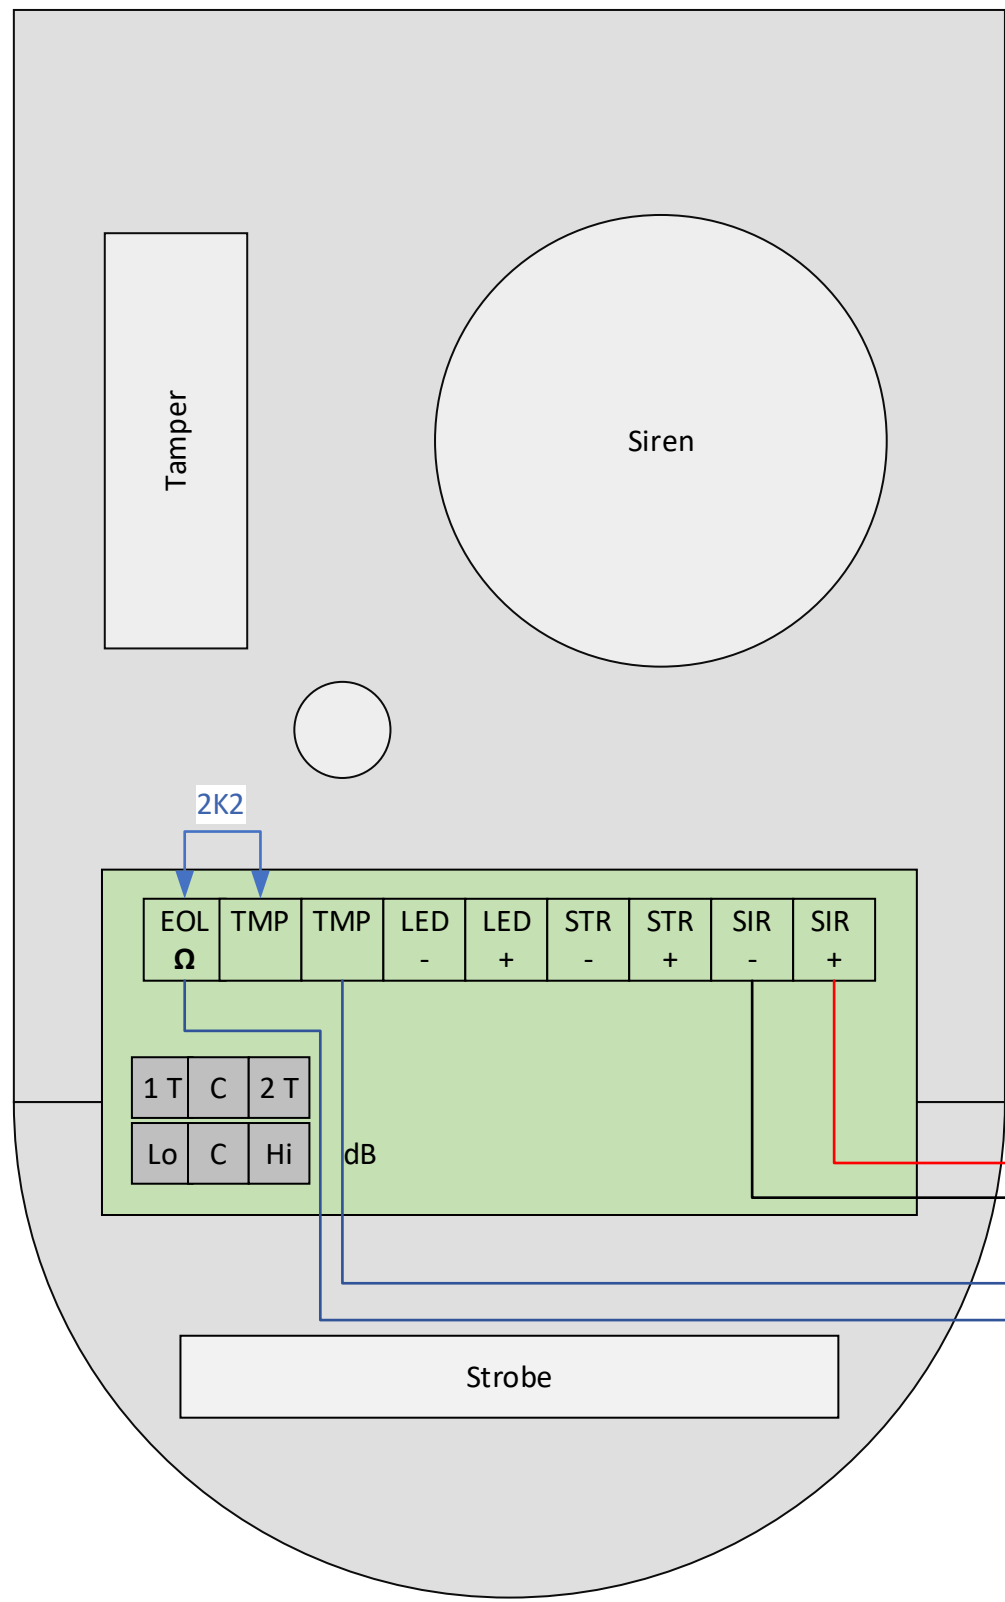


# LightSYS Plus Wiring Diagram

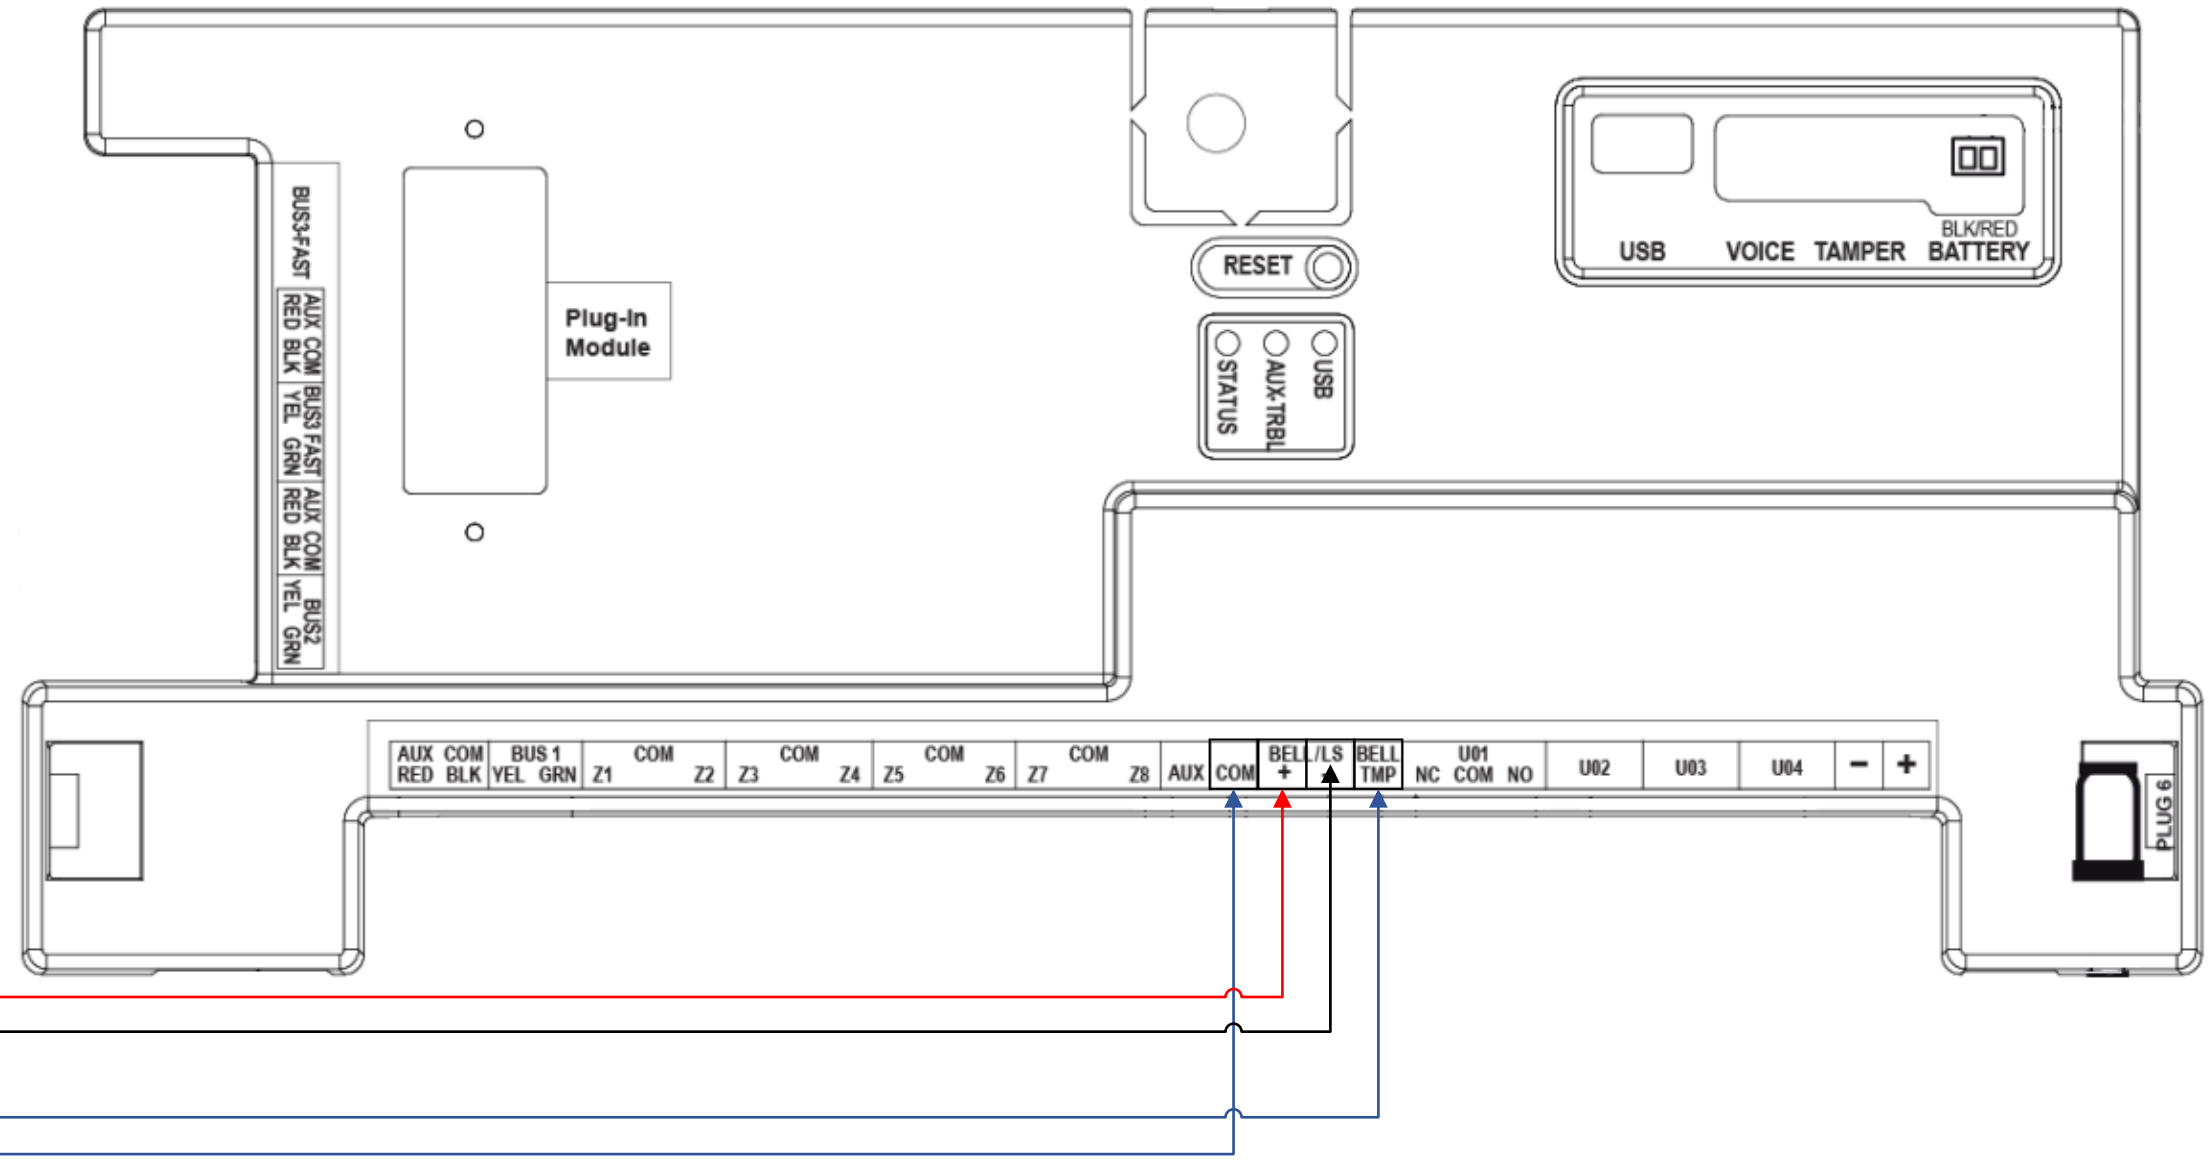

# Strobe Wiring

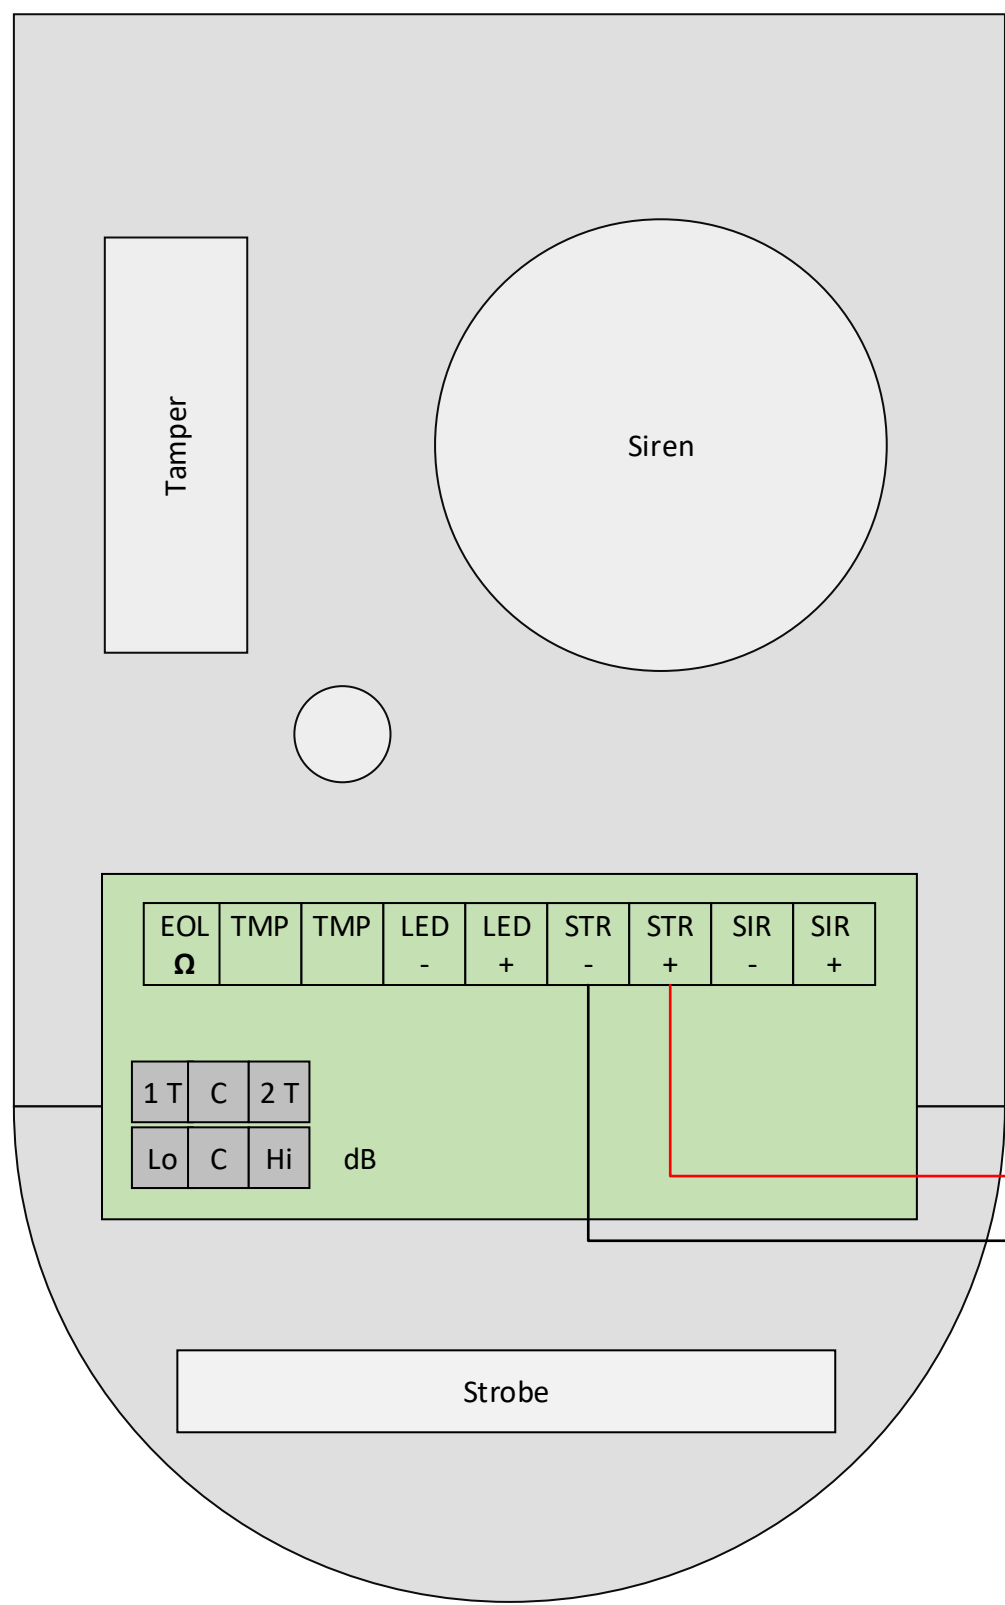

# LightSYS Plus Wiring Diagram

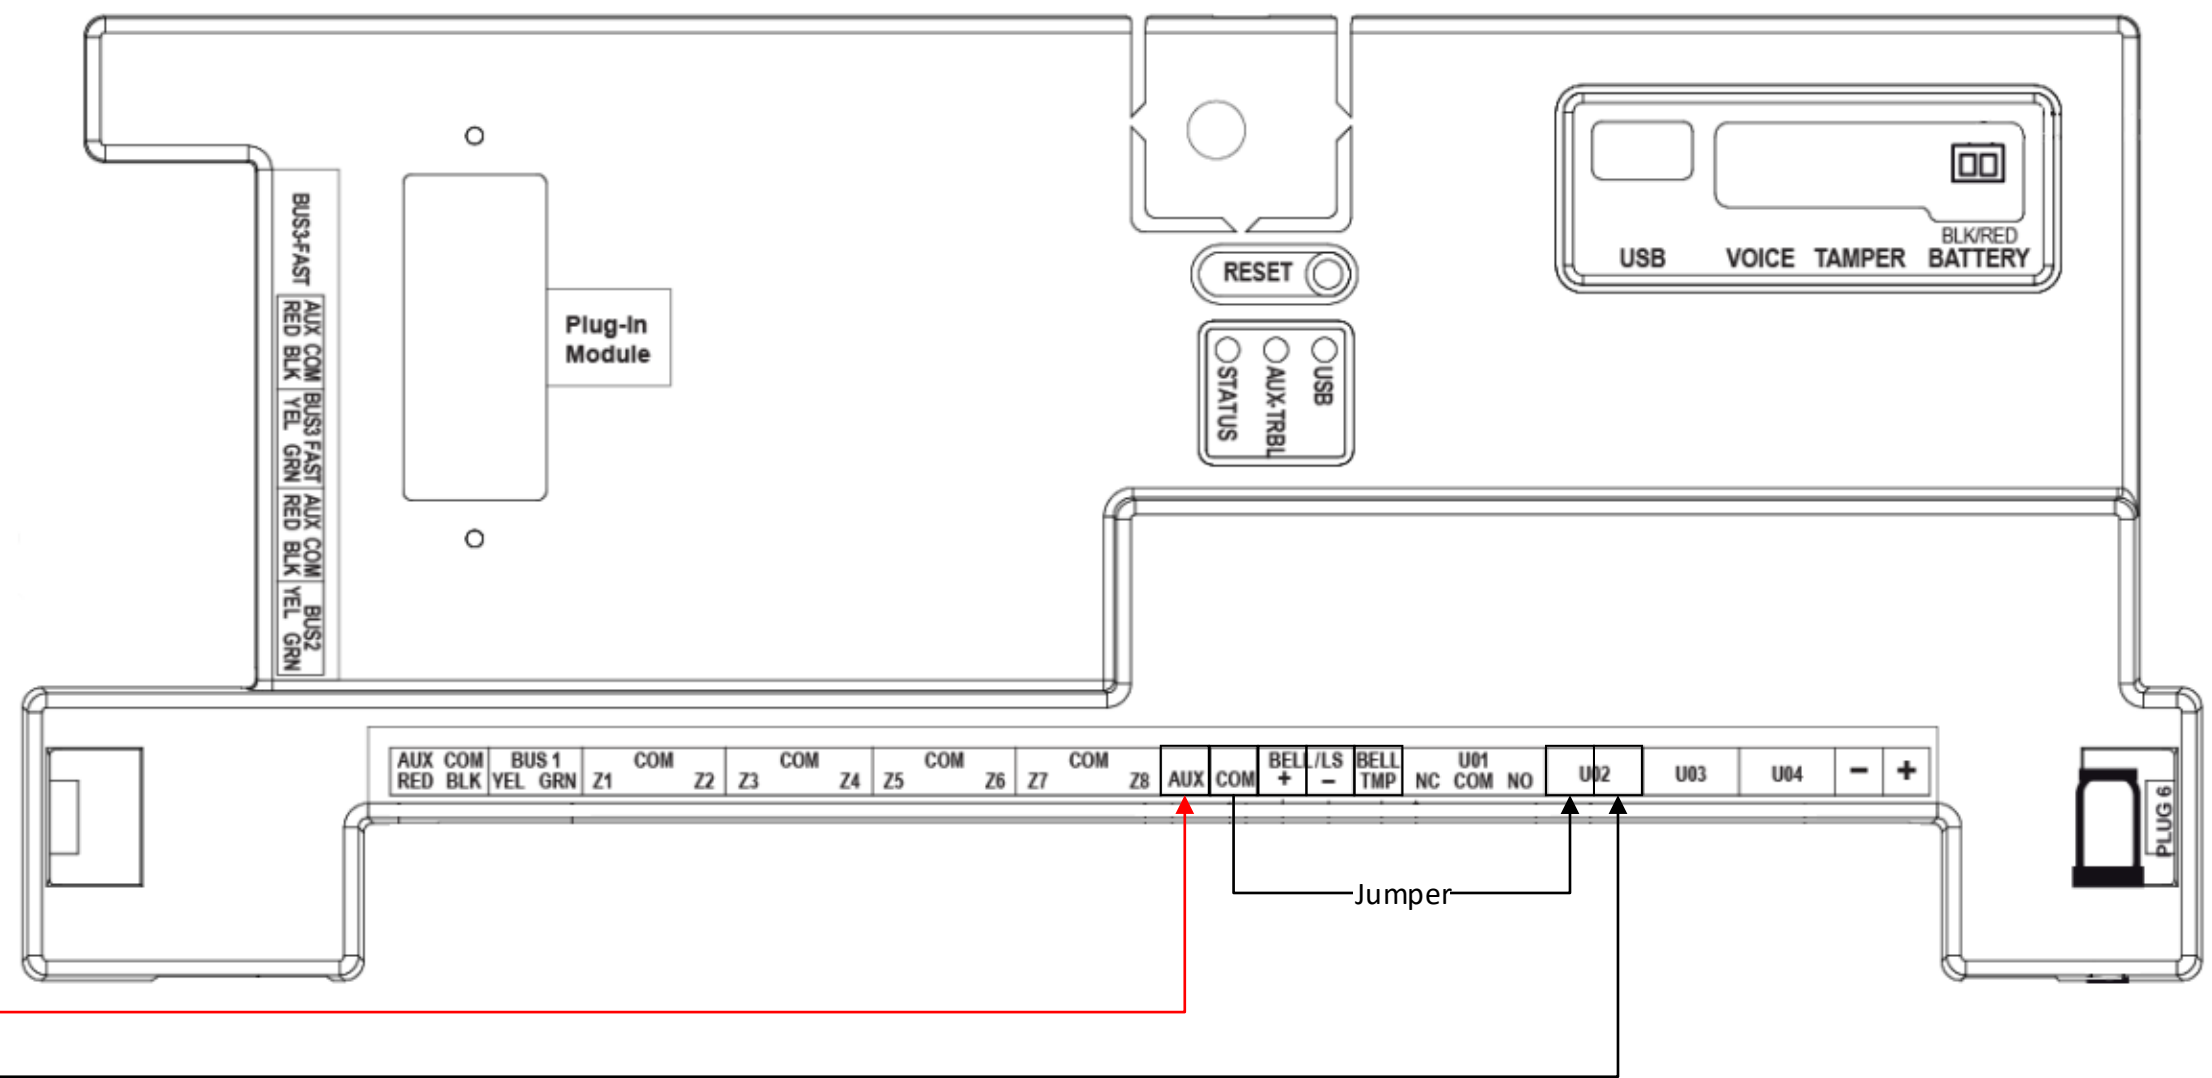

## Programming Addendum

In order to utilise Utility Output 2 (UO2) to trigger strobe the output must be programmed to Strob Trigger

Utility Outputs 2-3-4 are only rated for 100Ma @ 12V DC

No.	Label	Channel	Pattern	Pulse	Type	Follow Event
1	Output 1	0:00:01	Pulse Normally Open	5	None	
2	Output 2	0:00:02	Latch Normally Open		Follow Partition	Strob Trigger
3	Output 3	0:00:03	Pulse Normally Open	5	None	
4	Output 4	0:00:04	Pulse Normally Open	5	None	